


# Cherokee County Environmental Health

770-479-0444

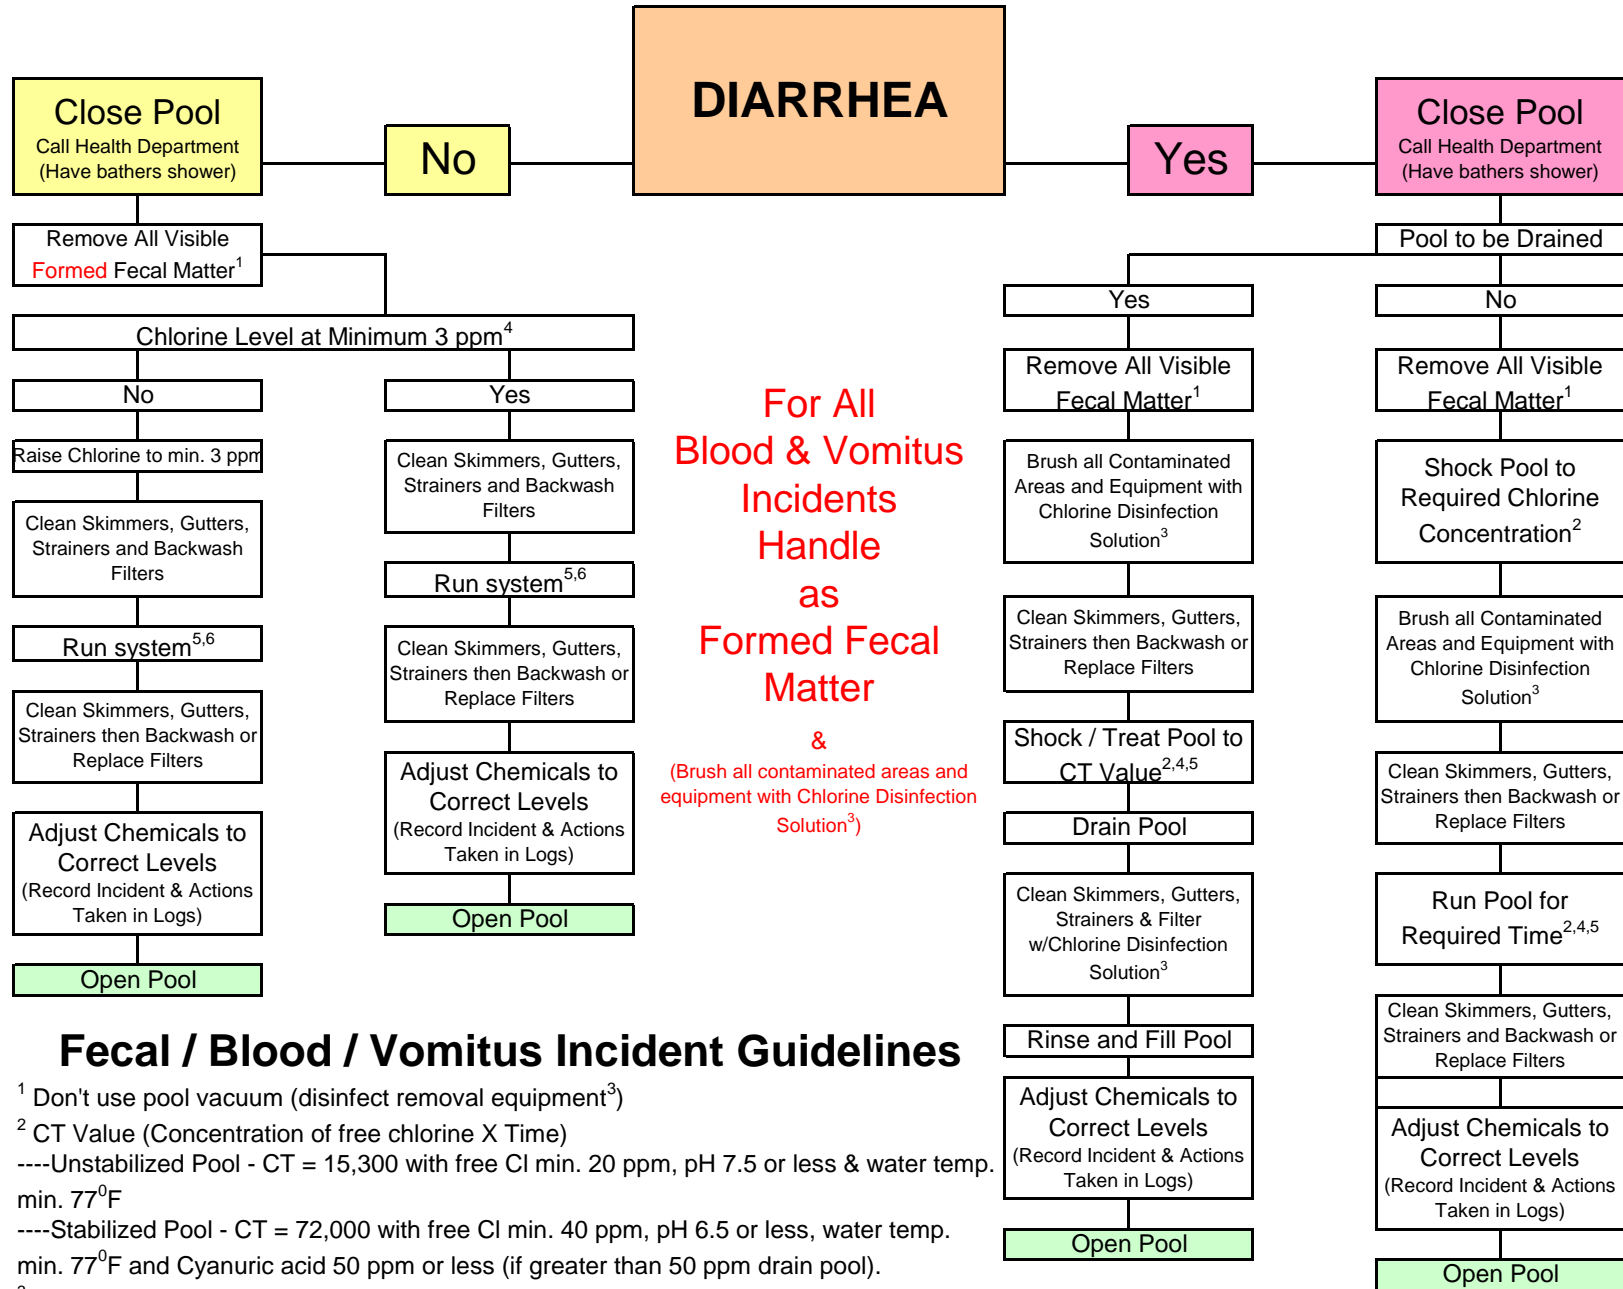

## Fecal / Blood / Vomitus Incident Guidelines

<sup>1</sup> Don't use pool vacuum (disinfect removal equipment<sup>3</sup>)

<sup>2</sup> CT Value (Concentration of free chlorine X Time)

----Unstabilized Pool - CT = 15,300 with free Cl min. 20 ppm, pH 7.5 or less & water temp. min. 77°F

----Stabilized Pool - CT = 72,000 with free Cl min. 40 ppm, pH 6.5 or less, water temp. min. 77°F and Cyanuric acid 50 ppm or less (if greater than 50 ppm drain pool).

<sup>3</sup> Sixteen ounces (1 pint) of household bleach with one gallon water (Soak area 30 min.)

<sup>4</sup> Maintain free chlorine concentration throughout run time and throughout entire pool

<sup>5</sup> Ensure all equipment, slides, mushrooms, etc. continue running

<sup>6</sup> Minimum 0.5 hours for unstabilized pools and minimum 1 hour for stabilized pools.